

LD310

Leak Detection


INTERNAL DIAGRAM

SW1 CONFIGURATION SETTINGS: 0 = OFF (SWITCH IS DOWN), 1 = ON (SWITCH IS UP)

SW1.1 - Audible Alarm
0 - Alarm Enabled
1 - Alarm Disabled

SW1.2 - Relay Outputs
0 - Non-supervised Relays
1 - Supervised Relays

SW1.3, SW1.4 - Leak Alarm Sensitivity
0,1 - Most Sensitive
0,0 OR 1,1 - Average Sensitivity
1,0 - Least Sensitive

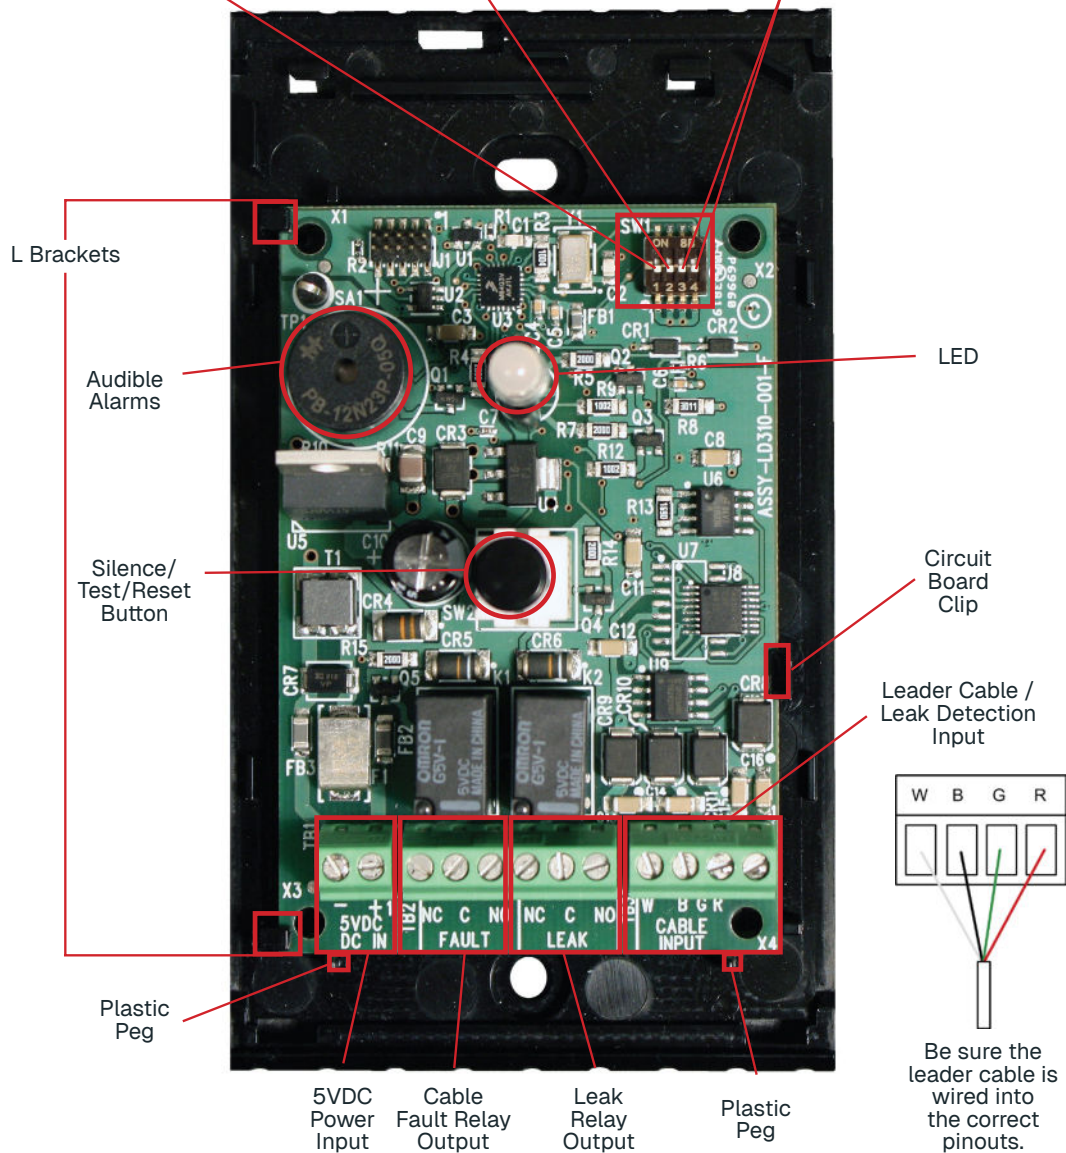

© Raymond & Lae Engineering, Inc. 2011. All rights reserved. RLE® is a registered trademark and Seahawk™, Falcon™, and Raptor™ are trademarks of Raymond & Lae Engineering, Inc. The products sold by RLE Technologies, 104 Racquette Dr., Fort Collins, CO 80524 are subject to the limited warranty, limited liability, and other terms and conditions of sale set forth at <https://www.rletech.com>.

04 CONNECT THE SENSING CABLE

Leader cable is used to connect sensing cable to the LD310, since sensing cable cannot connect directly to the device.

1. Insert the four stripped wires of the leader cable into the appropriate slots in the Cable Input terminal block at the bottom right corner of the LD310:

White wire: insert into pinout labeled W

Black wire: insert into pinout labeled B

Green wire: insert into pinout labeled G

Red wire: insert into pinout labeled R

2. Unscrew the EOL from the end of the leader cable.
3. Attach the length of sensing cable to the leader cable.
4. Route the sensing cable according to your cable layout diagram.
5. Secure the EOL to the unoccupied end of the sensing cable.process.

05 CONNECT THE RELAY OUTPUTS

The LD310 can be used as a stand-alone device, but it does have two Form C relay outputs that communicate leak and fault status to another device or system. If you wish to use the relay outputs, wire them at this time.the process.

06 CONNECT THE POWER SUPPLY

The LD310 requires an isolated 5VDC power supply.

A power supply is not included with the LD310, but an isolated 5VDC power supply (WA-DC-5-ST) is available from RLE.

To avoid product damage or personal injury, wire power to the slots labelled + and – in the DC IN terminal blocks. Establish all wiring connections, including sensing cable, relay outputs, and power before you activate the power supply.

07 SW1 CONFIGURATION SWITCHES

The LD310 has a set of four switches (SW1). A switch is off (0) when it is in the down position an on (1) when it is in the up position. If you change the switches, it may take up to 10 seconds for the system to recognize the change.

SW1.1 - Configure the Audible Alarm	
Down (0)	Audible alarm is enabled. This is the LD310's default setting.
Up (1)	Audible alarm is disabled.

07

SW1.2 - Configure the Relay Outputs

Down (0)	Relays are non-supervised - the relays remains OFF until an alarm is detected - at which time the relays turns ON. This is the LD310's default setting.
Up (1)	Relays are supervised - the relays remains ON until either power is disabled or an alarm is detected - at which time the relays turn OFF.

SW1.3 and SW1.4 - Set the Leak Alarm Sensitivity

SW1.3 is down (0) SW1.4 is up (1)	Relays are non-supervised - the relays remains OFF until an alarm is detected - at which time the relays turns ON. This is the LD310's default setting.
Both switches are either down (0,0) OR up (1,1)	Relays are supervised - the relays remains ON until either power is disabled or an alarm is detected - at which time the relays turn OFF.
SW1.3 is up (1) SW1.4 is down (0)	Low sensitivity - least sensitive - a larger amount of water needs to be present in order for the leak alarm to trigger.

08

LED

The LD310 has one LED, which is used to report a variety of conditions.

Power On / Normal - The LED is on and displays a solid green color during normal operation with no alarm present.

Cable Break - The LED flashes orange while the audible alarm sounds. Once the alarm silence button is pushed, the LED will continue to flash orange slowly until the cable break is resolved.

Leak - The LED flashes red while the audible alarm sounds. Once the alarm silence button is pushed, the LED will continue to display a solid red color until the leak is resolved and the cable is dry.

09 AUDIBLE ALARM AND SILENCE/TEST/RESET BUTTON

By default, the audible alarm on the LD310 is enabled. To disable the audible alarm, remove the unit's lid. Remove the warning sticker from the top of the audible alarm and change the switch at SW1.1 so it's in the 1 (up) position. Replace the lid. It may take up to 10 seconds for the unit to recognize the change.

The LD310 has one push-button switch which is used to silence the audible alarm and to test and reset the system.

The audible alarm sounds when a cable break or leak is detected. When the audible alarm is activated, push the button once to silence the alarm.

Test mode allows the LD310 to test its internal components. To initiate test mode, push and hold the button for approximately 5 seconds - when the LED flashes red and green, the audible alarm sounds, and the relays activate (change state) the test is complete. Release the button.

When you release the button after the test cycle, the entire unit resets and the LED returns to green. If there was a leak or cable break present before you ran the test and that leak or break is still present, the unit will alarm for this condition again after a few seconds.

10 TEST THE SYSTEM

Once the LD310 is set up, you should test the system. If the LD310 is connected to a BMS or NMS, notify monitoring personnel before you test.

To verify the LD310's functionality, test three points within the length of sensing cable - one at the beginning, one in the middle of the length, and another near the end of the length of cable.

There are a variety of ways to simulate a leak.

- Pour a small puddle of water on the cable while it rests on the floor.
- Dunk the cable in a cup of water.
- Wet a paper towel or rag and wrap it around the cable. Without damaging the cable, squeeze the towel until water drips off of the towel and wets the cable. This method is popular if the cable is used in pipe applications.

Remove simulated leak sources. Return the system to its normal operating state. To test the cable fault alarm, remove the end-of-line terminator (EOL) from the end of the sensing cable. This will cause a cable break, which should be reported appropriately by the LD310. Once the cable break alarm is verified, reapply the EOL and ensure the system returns to its normal operating state.


11

SW1 CONFIGURATION SETTINGS: 0 = OFF (SWITCH IS DOWN), 1 = ON (SWITCH IS UP)

SW1.1 - Audible Alarm
 0 - Alarm Enabled
 1 - Alarm Disabled

SW1.2 - Relay Outputs
 0 - Non-supervised Relays
 1 - Supervised Relays

SW1.3, SW1.4 - Leak Alarm Sensitivity
 0,1 - Most Sensitive
 0,0 OR 1,1 - Average Sensitivity
 1,0 - Least Sensitive

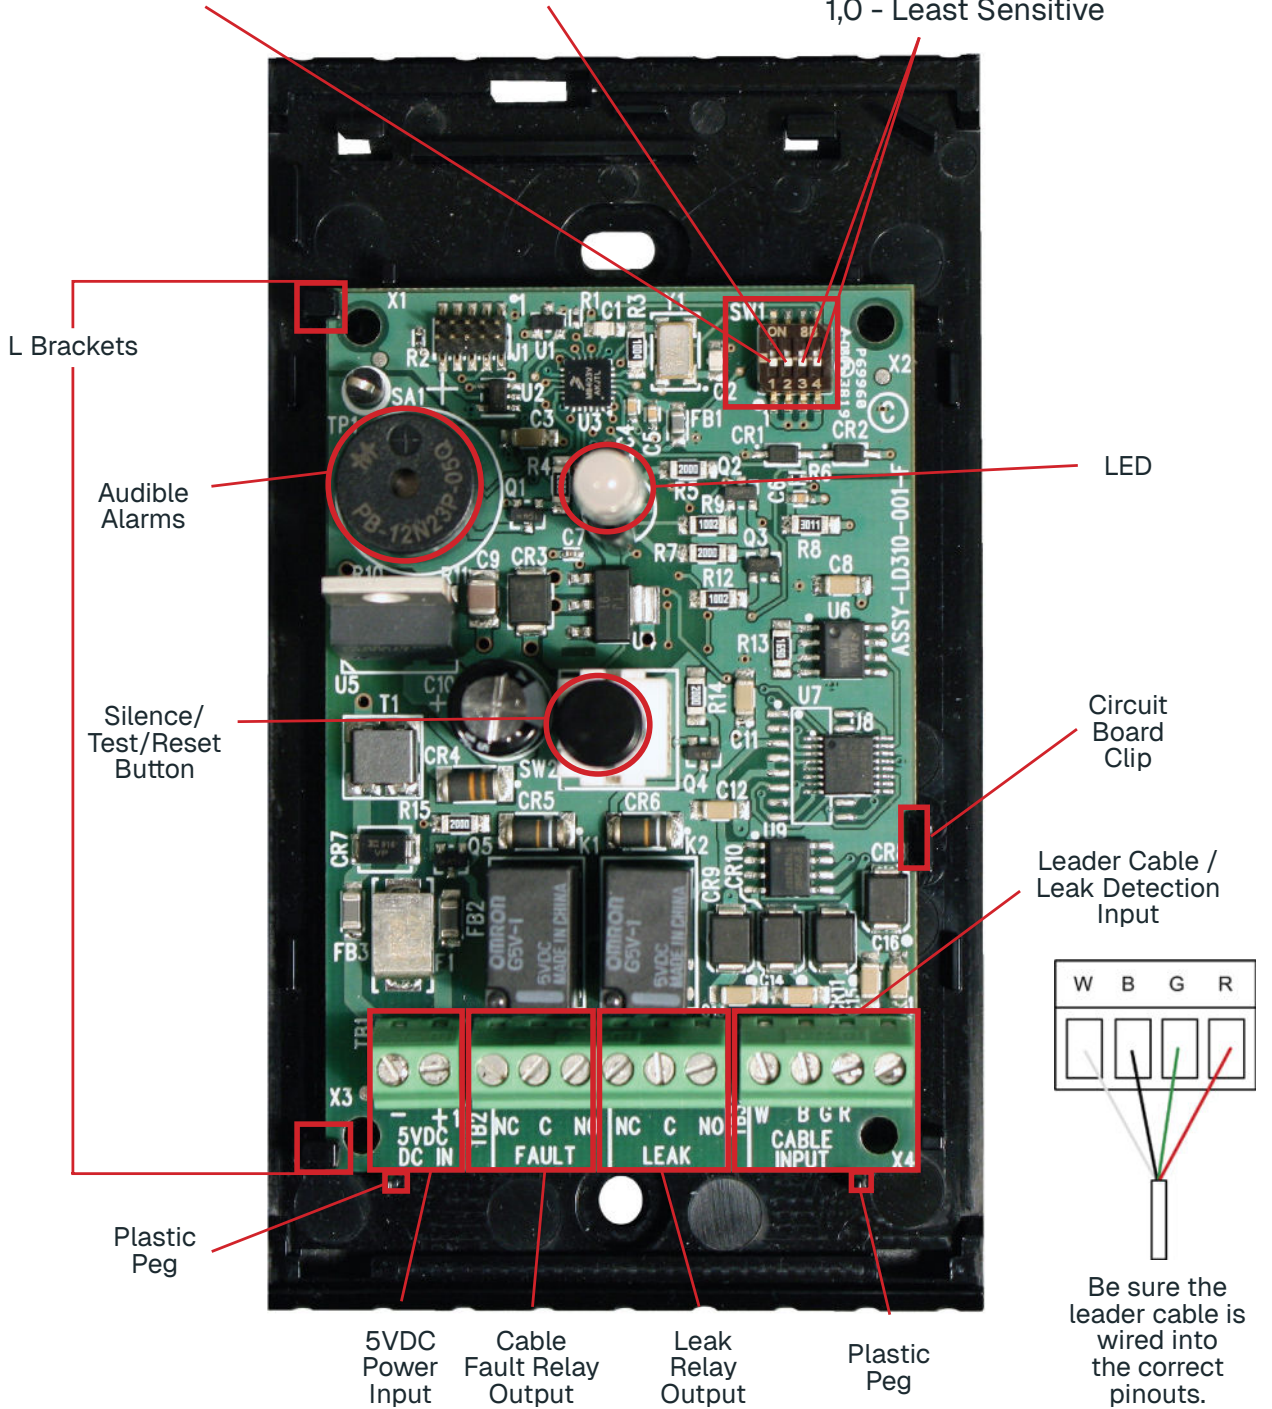

© Raymond & Lae Engineering, Inc. 2011. All rights reserved. RLE® is a registered trademark and Seahawk™, Falcon™, and Raptor™ are trademarks of Raymond & Lae Engineering, Inc. The products sold by RLE Technologies, 104 Racquette Dr., Fort Collins, CO 80524 are subject to the limited warranty, limited liability, and other terms and conditions of sale set forth at <https://www.rletech.com>.